

**Addendum No. 5  
to  
Contract Documents**

McKinley Street Interceptor

for the

City of Hollywood


City Project No. 07-7059

January 4, 2010

To all Bidders:

Bidders for the above referenced project shall take note of the following changes, additions, deletions, clarifications, etc. to the Plans and Specifications, which in accordance with the Contract Documents shall become a part of and have precedence over anything shown or described otherwise.

Bidders must acknowledge receipt of addenda on Page 00300-1 of the Proposal of the Bidding Package.

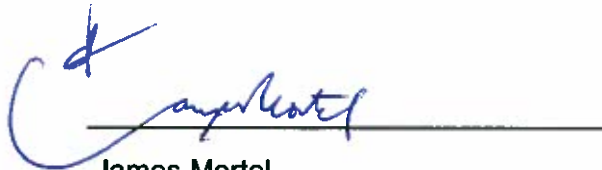

James Mortel  
Project Manager  
Engineering and Construction Services Division  
Department of Public Utilities  
City of Hollywood, Florida

## **SPECIFICATIONS**

### **A. SECTION 01520 – MAINTENANCE OF FACILITIES AND SEQUENCE OF CONSTRUCTION**

1. On page 01520-10, paragraph 1.08, add the following:

”O. WORK AT INTERCEPTOR BOX:

1. CONTRACTOR shall be responsible for continuous service of the gravity sewer system and shall collect and/or bypass sanitary sewers if required by the work.
2. Before commencing work involving cutting or removing portions of the existing 60-inch RCP gravity sewer, the CONTRACTOR shall notify the CITY at least fourteen (14) days in advance in writing.
3. CONTRACTOR shall plan construction activities for cutting/removing the section of 60-inch RCP gravity sewer during low flowrate conditions, which are anticipated to occur during nighttime hours.
4. CONTRACTOR shall be responsible for continuous service of the existing 60-inch RCP gravity sewer and shall collect and/or bypass sanitary sewer flows if required by the work.
5. Operation of the existing 60-inch RCP cannot be interrupted until the 66-inch McKinley Street Interceptor is placed into service.
6. Additional requirements for the work at the interceptor box are shown on the Drawings.”

### **B. SECTION 15006 – DUCTILE IRON PIPE**

1. On page 15006-2, paragraph 2.01 (A), delete the words “Section 15000- Piping” and replace them with “Section 15390 – Piping Schedule”.
2. On page 15006-4, paragraph 2.01 (E)(1), delete this paragraph in its entirety and replace it with the following:

“Shall be manufactured in accordance with AWWA/ANSI C110/A21.10 or AWWA/ANSI C153/A21.53 and AWWA/ANSI C111/A21.11. All below grade fittings shall be restrained as set forth in paragraph 2.01 (D) (2) above or may be mechanical joints restrained with as set forth in paragraph 2.01 (D) (3) above.”


## **DRAWINGS**

### **SHEET S-3 – INTERCEPTOR BOX EXCAVATION DETAILS SHEET 1**

1. Delete this sheet in its entirety and replace it with attached Sheet S-3.


**SHEET S-4 – INTERCEPTOR BOX EXCAVATION DETAILS SHEET 2**

1. On Note 22, delete the words "Pump the groundwater to plant as specified".

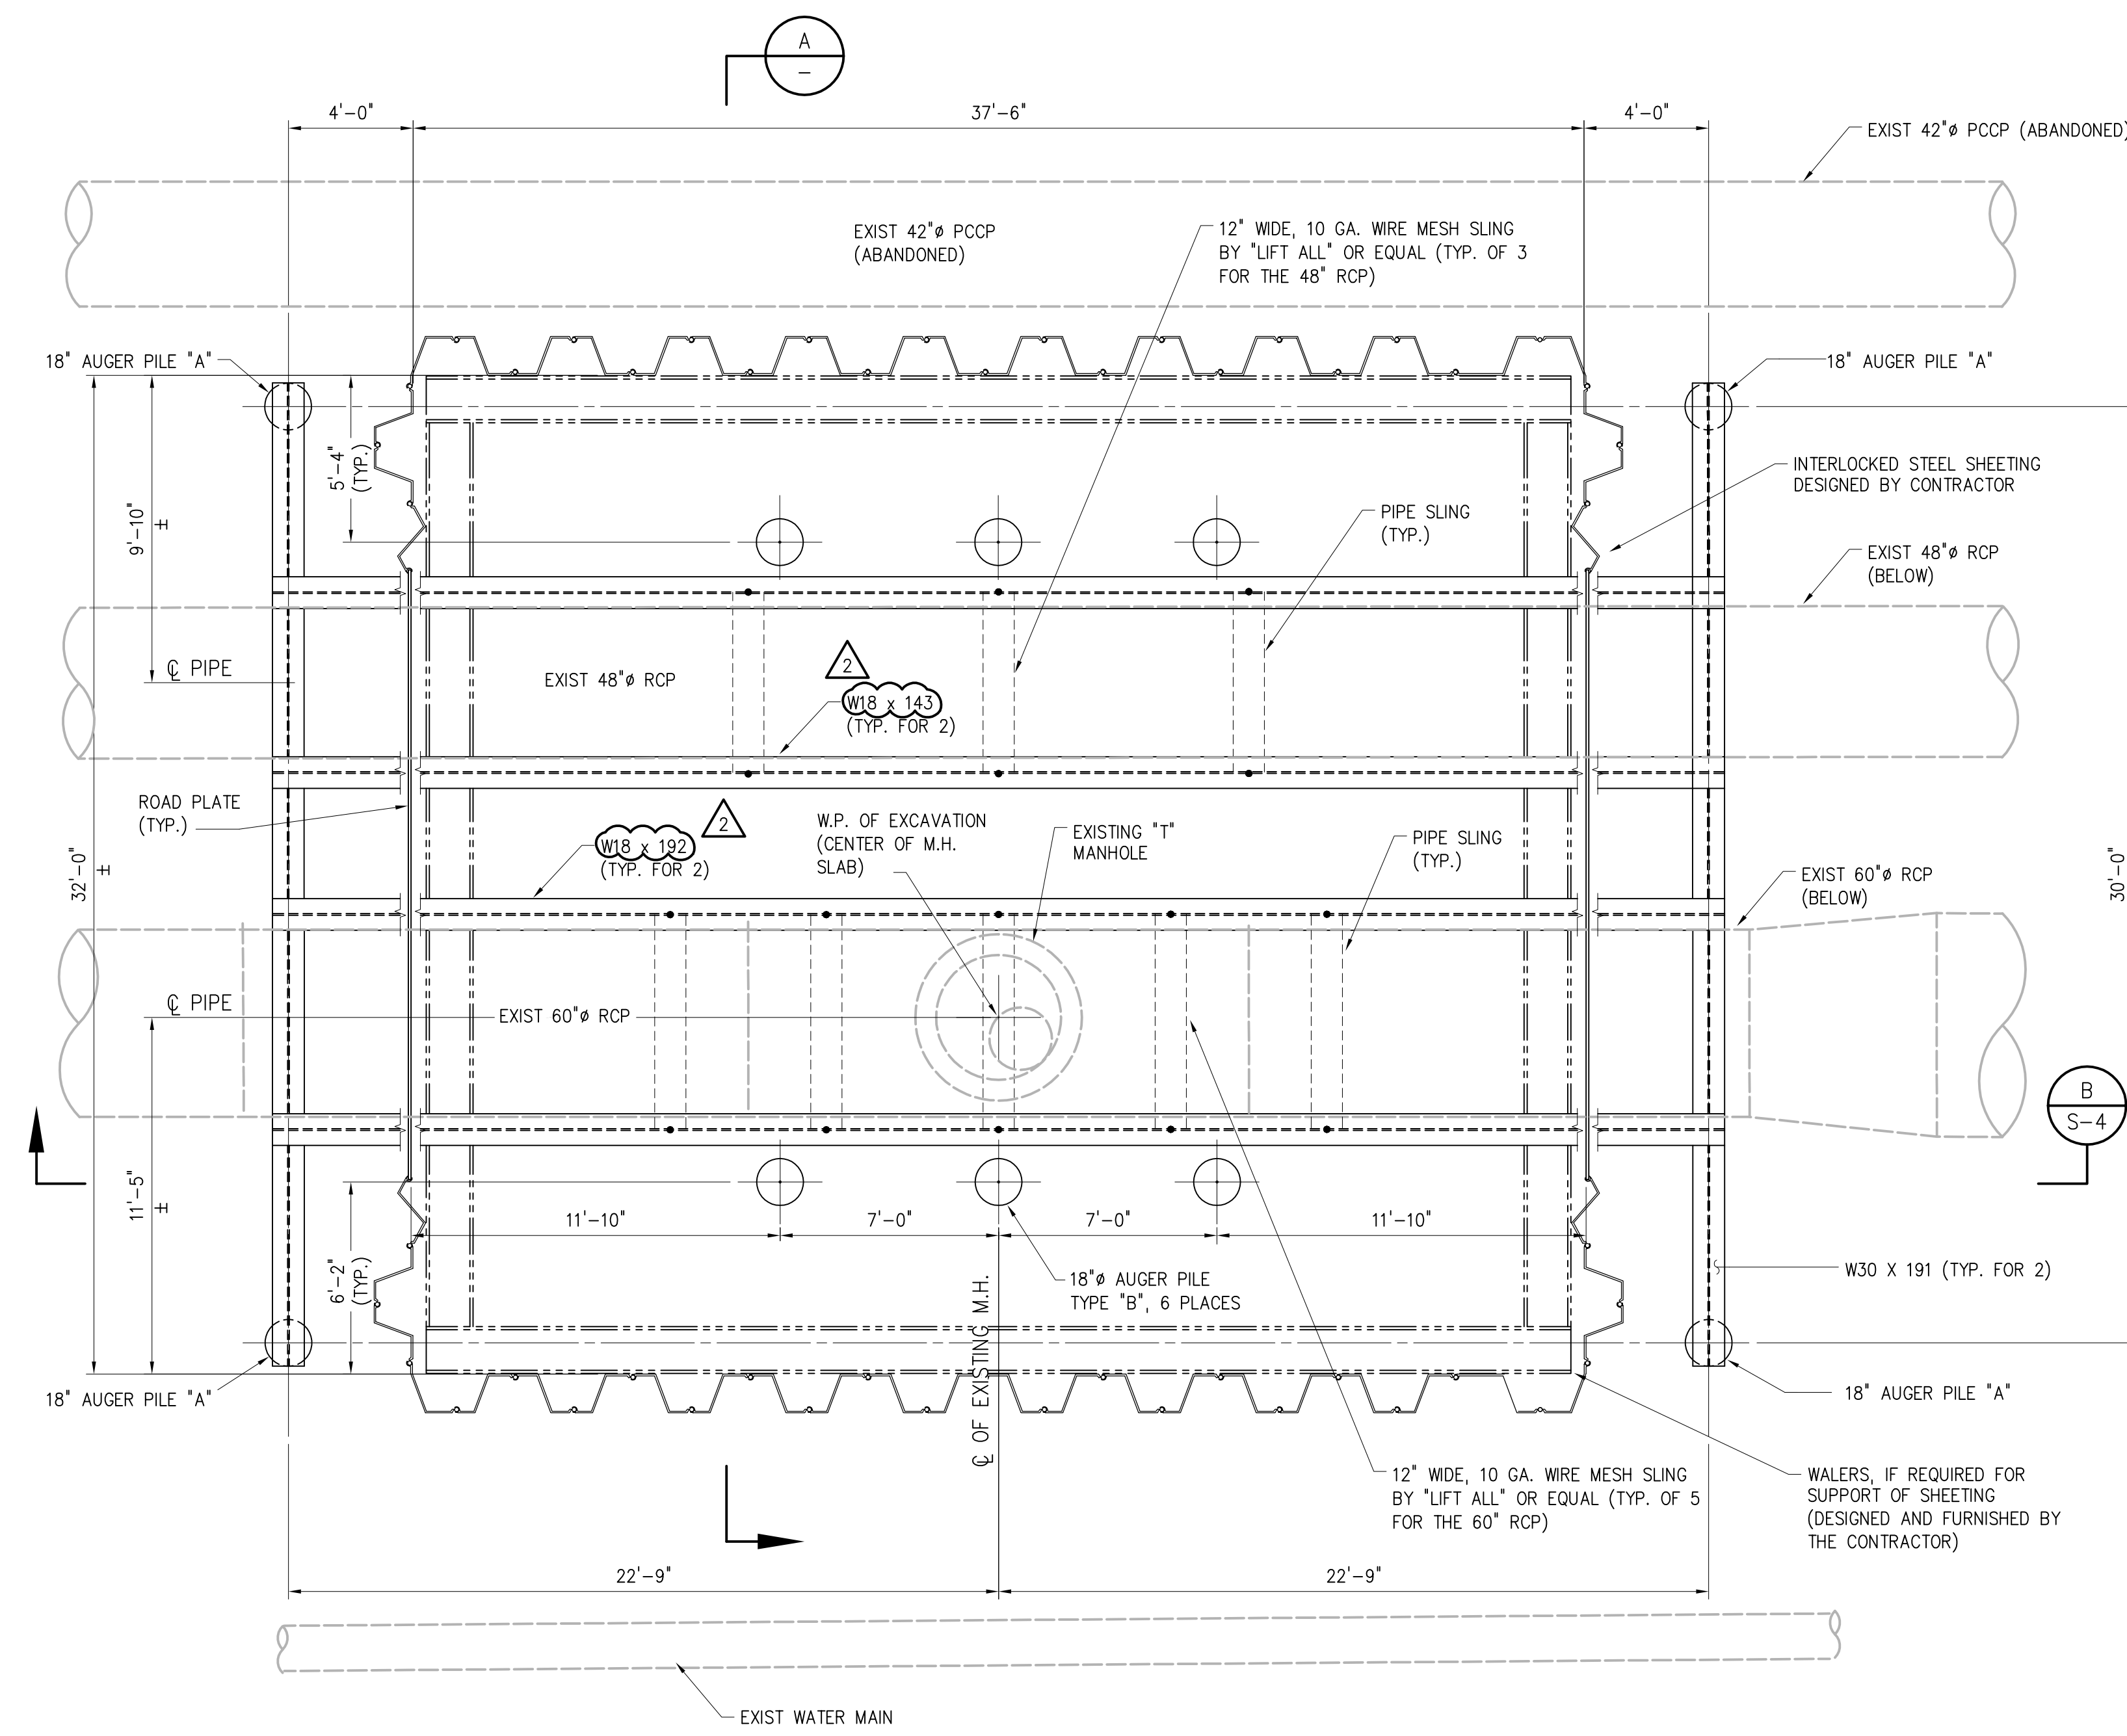

EXCAVATION - PLAN


1"=4'

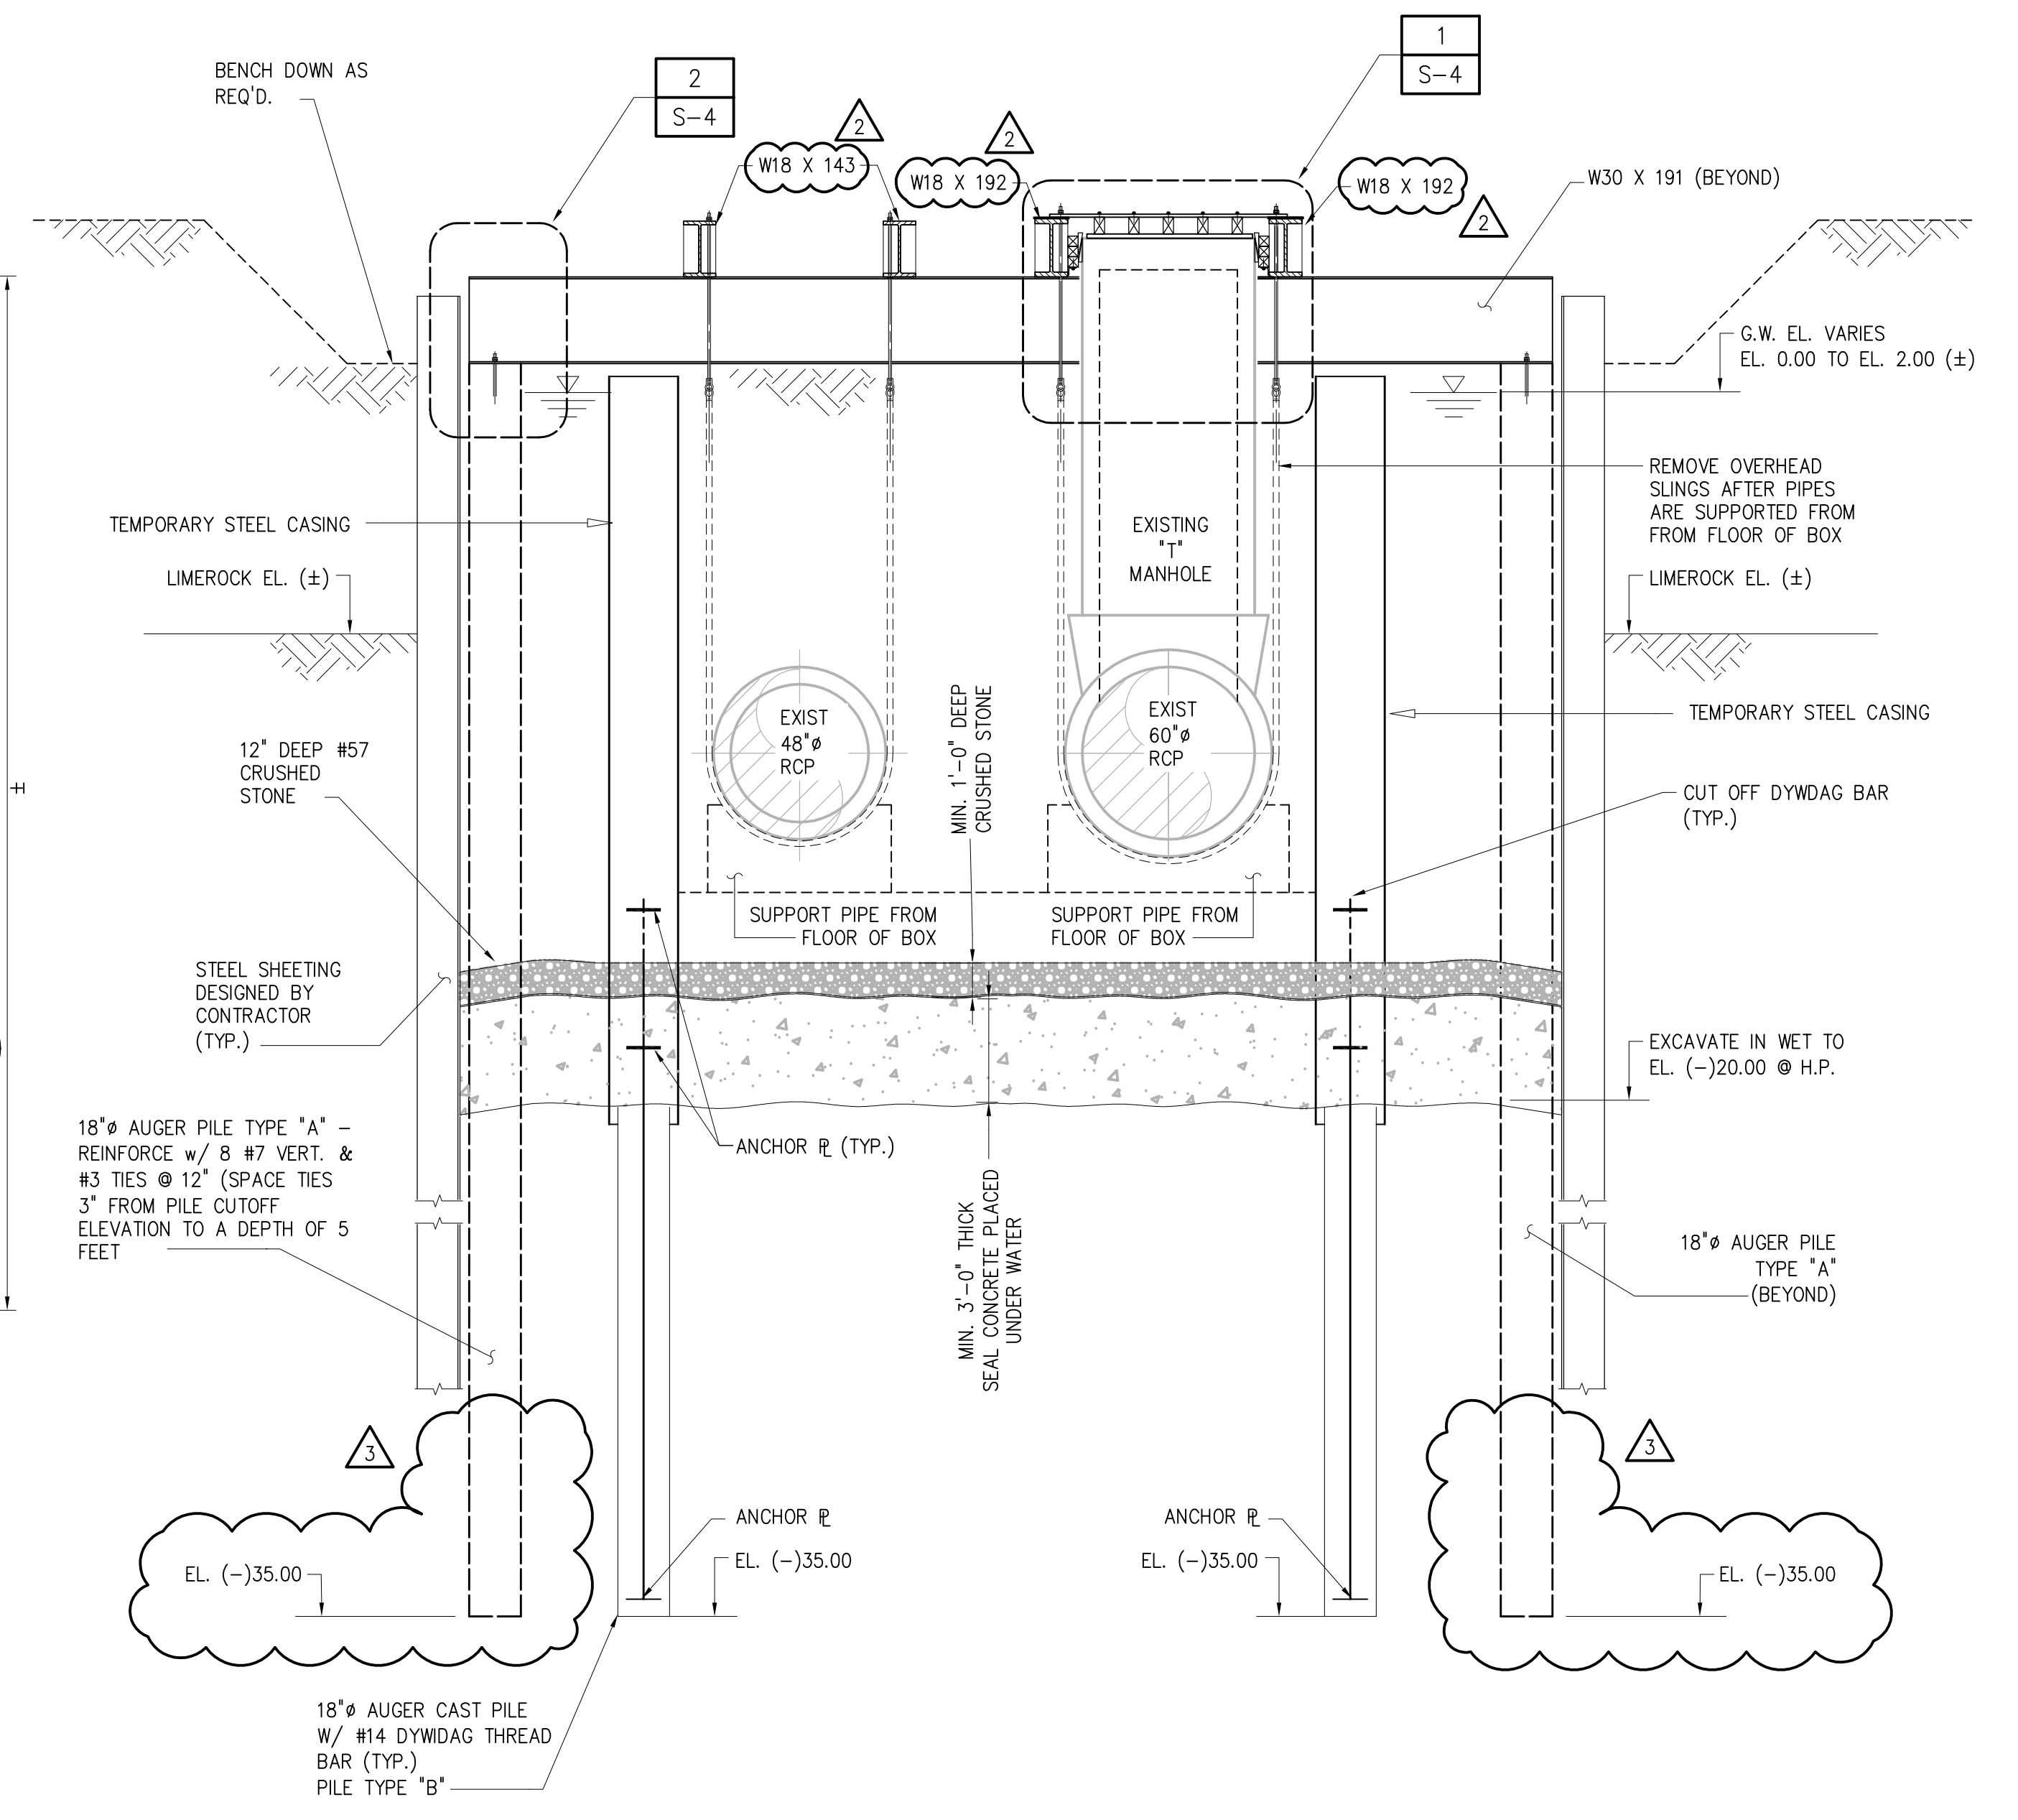

SECTION A-A

1"=4'

- NOTE:
1. THE CONTRACTOR SHALL SUBMIT DETAILED LAYOUT DRAWINGS AND SHOP DRAWINGS OF COFFERDAM, STEEL PIPE SUPPORTS AND AUGER PILES IN ACCORDANCE WITH SECTION 01300.
  2. COST FOR THE WORK SHOWN SHALL BE INCLUDED IN THE CONTRACT PRICE. CONTRACTOR MAY AT ITS OPTION, SUBMIT ALTERNATE METHODS AND MEANS TO SUPPORT THE PIPE AND EXISTING MANHOLE, AND PERFORM THE EXCAVATION AND DEWATER FOR THE CONSTRUCTION OF THE INTERCEPTOR BOX. ANY DEVIATION TO THE SPECIFIED METHOD WILL BE SUBJECT TO APPROVAL BY THE ENGINEER.

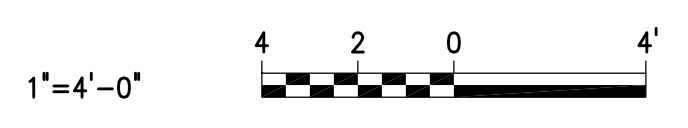

PLOT DATE: 12/21/2009 11:40 AM BY: GDAZ

DESIGNED	S.J.		
DRAWN	G.P.B.		
CHECKED	A.F.H.		
PROJ. ENGR.	S.J.		
NO.	DATE	ISSUED FOR	BY
3	12-21-09	ADDENDUM No. 5	JPC
2	10-26-09	ADDENDUM No. 3	SJ
1	8-03-09	BIDDING	SJ

DESIGNED: S.J.  
 DRAWN: G.P.B.  
 CHECKED: A.F.H.  
 PROJ. ENGR.: S.J.

SHAJAN JOYKUTTY  
 No. 43323 P.E.

**HAZEN AND SAWYER**  
 Environmental Engineers & Scientists  
 4000 Hollywood Boulevard, Suite 750N  
 Hollywood, Florida 33023  
 Certificate of Authorization Number: 2771

SCALE  
 1"=4'

CONTRACT: -  
 CLIENTS PROJECT: 07-7059  
 ENGINEERS PROJECT: 4321-024  
 CAD REFERENCE: 4321-024503



CITY OF HOLLYWOOD

SOUTHERN REGIONAL WASTEWATER COLLECTION SYSTEM  
 MCKINLEY STREET INTERCEPTOR  
**INTERCEPTOR BOX  
 EXCAVATION DETAILS SHEET 1**

DATE: 8/3/09  
 SHEET: 60 OF 61  
 DRAWING: S-3

BID DOCUMENTS