


PLAN STREET

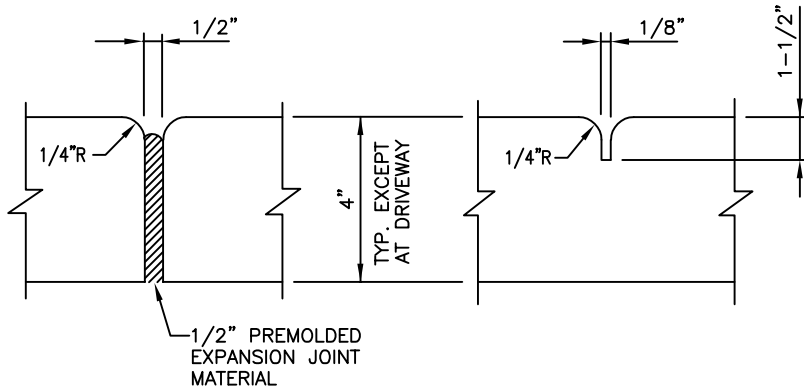

TYPE 'A'

TYPE 'B'

SIDEWALK JOINTS

TABLE OF SIDEWALK JOINTS	
TYPE	LOCATION
'A'	P.C. & P.T. OF CURVES; JUNCTION OF EXISTING AND NEW SIDEWALKS; WHERE SIDEWALK ABUTS CONCRETE CURBS, DRIVEWAYS AND SIMILAR STRUCTURES.
'B'	5' CENTER TO CENTER ON SIDEWALKS.

NOTES:

1. CONCRETE SHALL BE CLASS 1 WITH MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS.
2. USE OF FIBER REINFORCED CEMENT IS PROHIBITED.
3. SIDEWALK LONGITUDINAL AND CROSS SLOPES SHALL MEET ADA STANDARDS.
4. SIDEWALK CURB RAMPS SHALL BE PROVIDED AT ALL DESIGNATED PEDESTRIAN CROSSING AT INTERSECTIONS PER FDOT STANDARD PLANS INDEX NO. 522-002.
5. THE VERTICAL DEVIATION OF THE COVER/LID OF A GIVEN UTILITY BOX/STRUCTURE SHALL NOT BE MORE THAN A 1/4" DIFFERENCE IN HEIGHT/ELEVATION OF THE FINISHED SIDEWALK SURFACE.
6. 4" THICK MINIMUM (TYP.); 6" THICK AT DRIVEWAYS, EXTENDED TWO FEET ON BOTH SIDES BEYOND THE DRIVE.



ISSUED: MAY 2023	DEPARTMENT OF DEVELOPMENT SERVICES ENGINEERING, TRANSPORTATION & MOBILITY DIVISION	REVISED: -
DRAWN: EG	SIDEWALK CONSTRUCTION DETAILS (3 OF 3)	DRAWING NO.:
APPROVED: JG		C-25